


MAINLINE INSPECTION (CCTV)
MANHOLE INSPECTION
MANHOLE REHABILITATION
MAINLINE REHABILITATION (CIPP)
UNABLE TO COMPLETE
MANHOLE INSERT

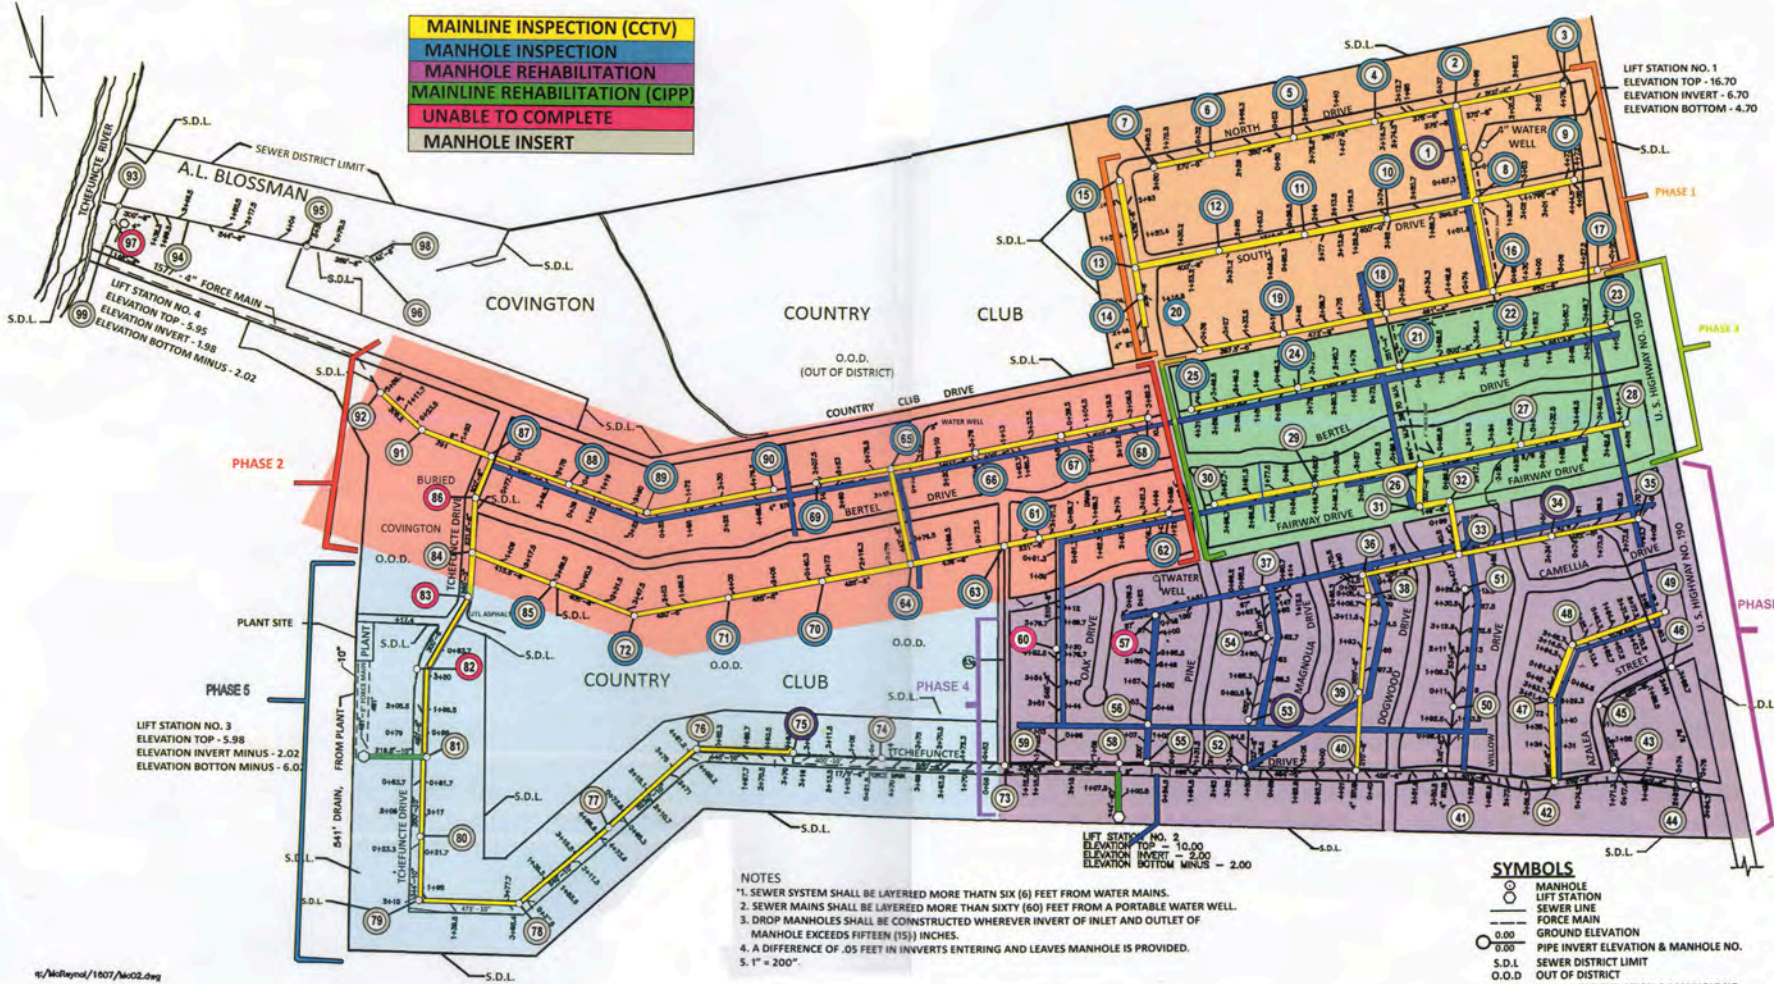

- NOTES**
1. SEWER SYSTEM SHALL BE LAYERED MORE THAN SIX (6) FEET FROM WATER MAINS.
  2. SEWER MAINS SHALL BE LAYERED MORE THAN SIXTY (60) FEET FROM A PORTABLE WATER WELL.
  3. DROP MANHOLES SHALL BE CONSTRUCTED WHEREVER INVERT OF INLET AND OUTLET OF MANHOLE EXCEEDS FIFTEEN (15) INCHES.
  4. A DIFFERENCE OF .05 FEET IN INVERTS ENTERING AND LEAVES MANHOLE IS PROVIDED.
  5. 1" = 200"

**SYMBOLS**

○	MANHOLE
○	LIFT STATION
—	SEWER LINE
—	FORCE MAIN
○	GROUND ELEVATION
○	PIPE INVERT ELEVATION & MANHOLE NO.
—	S.D.L. SEWER DISTRICT LIMIT
—	O.O.D. OUT OF DISTRICT
—	PIPE INVERT ELEVATION & MANHOLE NO
—	SEWER ENTRANCE
—	N.G. ELEVATIONS